


BUREAU ENGINEER *[Signature]* DRAFTSMAN, E.W.E. DATE 5-23-79 SCALE N/T/S
 BUREAU

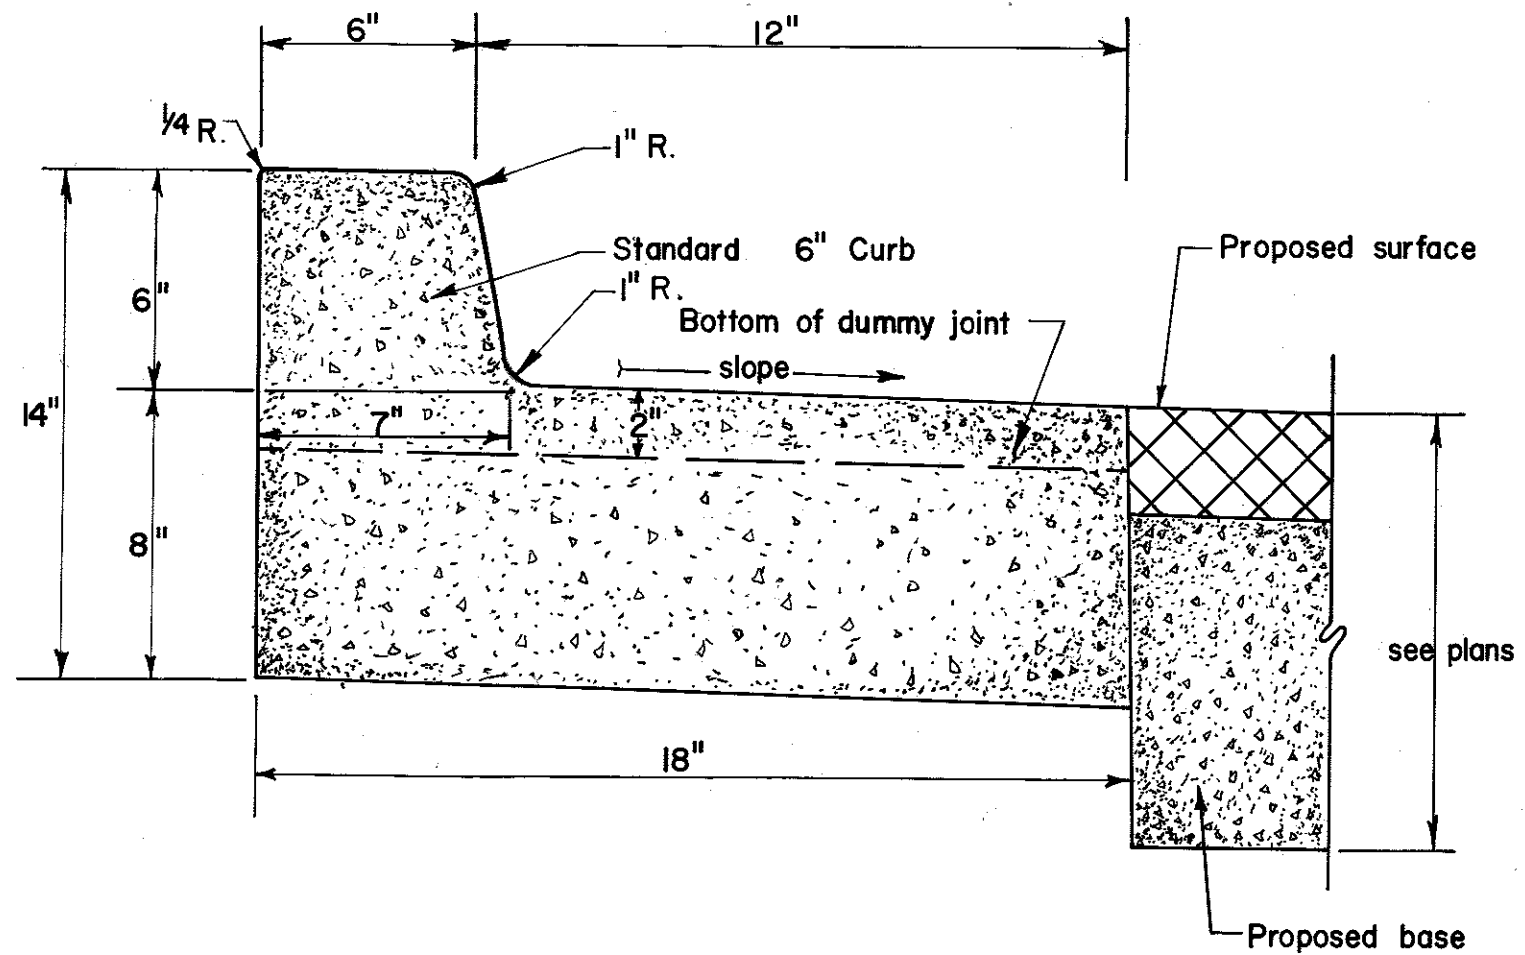

- NOTES:**
1. Pre-cut exp. joints material shall be used in all exp. joints.
 2. Dummy joints shall be installed at 10ft. intervals, maximum.
 3. Exp. joints shall be installed at 40ft. maximum.
 4. Exp. joints shall be installed at ends of radius.
 5. Exp. joints shall be located a minimum of 5ft. from inlet structures.
- Conc. to be CLASS 'A'
(6bag min)

Slope 3/16" per ft. or same slope as pavement

REVISIONS			
NO.	DATE	BY	REMARKS
1	5-30-85	L.R.H.	REMOVED DIV. OF PUBLIC WORKS (T. BLK.)
2	7-7-87	D.H.G.	REMOVED 3000 PSI, ADDED CLASS 'A'
3	1-29-88	D.H.G.	REMOVE DEPARTMENT (T. BLK.)

CONVERSIONS	
ENGLISH	METRIC

CITY OF MEMPHIS
 DIVISION OF ENGINEERING

DESIGN STANDARD
 FOR
6-18 MEDIAN CURB

<i>[Signature]</i>	7-5-79
PRINCIPAL CIVIL ENGINEER	DATE
<i>[Signature]</i>	7-5-79
DEPUTY DIRECTOR/CIVIL ENGINEER	DATE