


9-30 CURB AND GUTTER

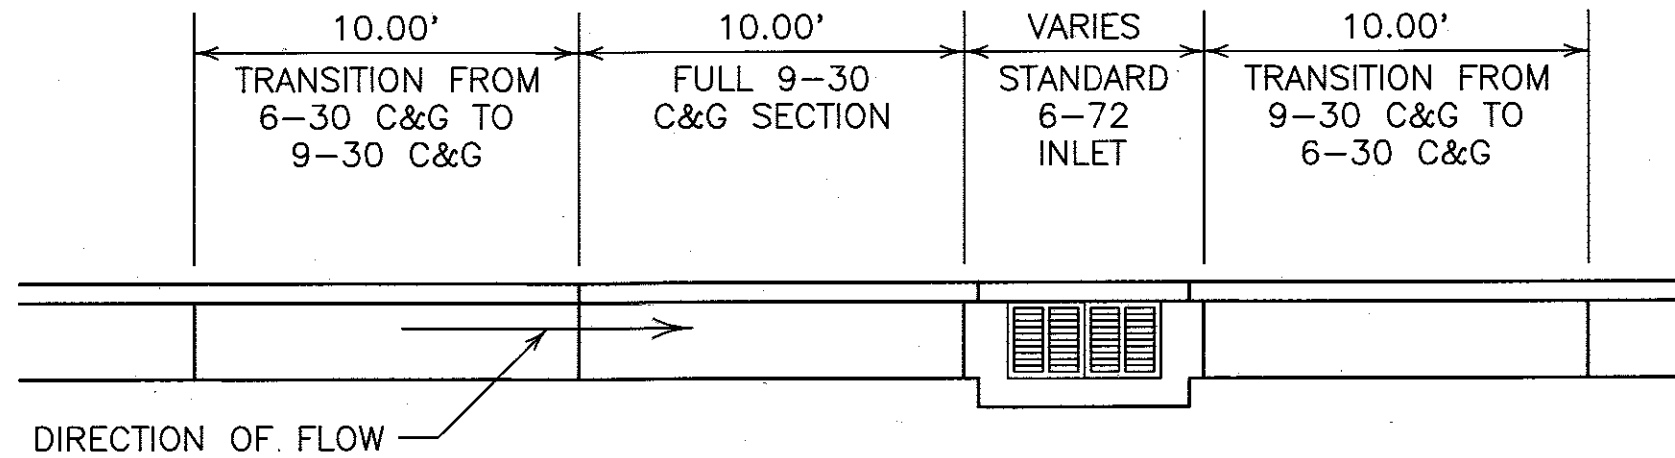

REVISIONS			
NO.	DATE	BY	REMARKS

NOTES:

1. Pre-cut exp. joint material shall be used in all exp. joints.
2. Exp. joint material shall be installed at ends of transition sections.
3. Exp. joint material shall be installed at a minimum of 5 ft. from inlet structures.
4. Conc. to be Class 'A' (6 bag min).

CITY OF MEMPHIS
DIVISION OF ENGINEERING

**DESIGN STANDARD
FOR
9-30 CURB AND TRANSITION**

Jenn Hallen, P.E. 7-30-90
DEPUTY CITY ENGINEER DATE
Bryant Bondurant P.E. 7-31-90
CITY ENGINEER DATE